




fire & smoke test data

All STS acoustic data is sourced, supplied and verified by independent, UKAS-accredited test facilities in accordance with all relevant British and European standards.

Approved Document 'B' (Fire Safety)
Approved Document 'M' (Access To and Use of Buildings)

- BS 9999
- BS 476: 22 - 1987
- BS 8214 - 2008
- BS EN 1634 - 1: 2008
- BS EN 1634 - 3: 2004
- BS 476: 31 - 1

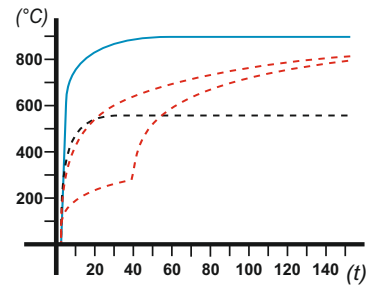


STS INTUMESCENT LOCK KITS

Standard DIN lock


:XX

FD30 version

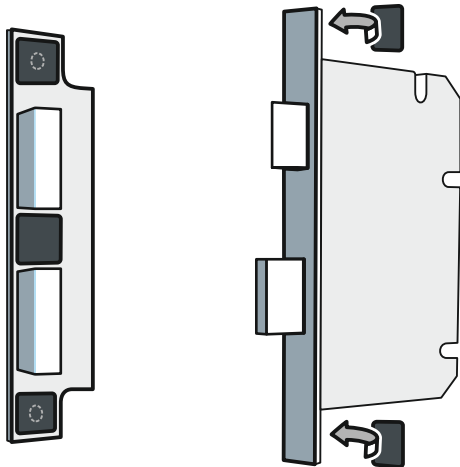


Strike (rear view)


DIN lock



Kit consists of 5no. pieces
25mm x 25mm


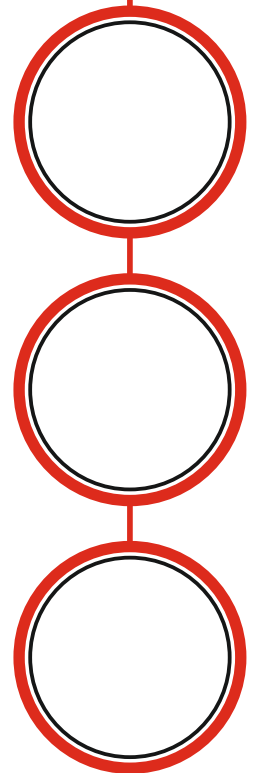


FD60 version

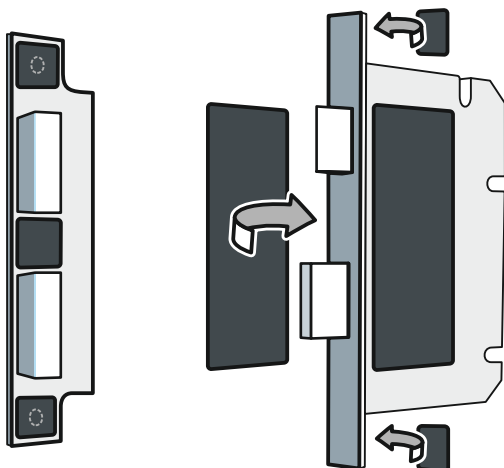

Strike (rear view)

DIN lock

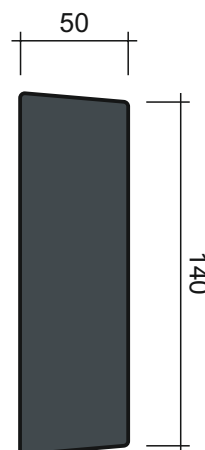

Kit consists of 7no. pieces
5no. @ 25mm x 25mm
2no. @ 50mm x 140mm